


SEE CITY STANDARD DETAIL NO. 01.05.02  
FOR LUMINAIRE SPECIFICATION

ARM END WIRE SUPPORT, SEE CITY  
STANDARD DETAIL NO. 01.05.07

**NOTES:**

1. A METER SERVICE DISCONNECT IS REQUIRED FOR EACH BRANCH CIRCUIT. SEE CITY STANDARD DETAIL NO. 01.05.05
2. INSTALLATION SHALL CONFORM TO NATIONAL ELECTRICAL CODE, WSDOT, AND CITY STANDARDS.
3. PHASING TAPE IS NOT ALLOWED.
4. ALL WIRES SHALL BE INSTALLED IN CONDUIT AS SPECIFIED ABOVE.
5. ALL SPLICES SHALL BE MADE IN A JUNCTION BOX. WIRE NUTS WILL NOT BE ALLOWED. SPLICES SHALL BE CENTERED AND ENCASED IN 3M SCOTCHCAST EPOXY KIT TYPE 82-A1, 82-B1, OR CITY APPROVED EQUAL. OTHER GEL TAP SPLICE KITS AND DIRECT BURIAL AND SUBMERSIBLE SPLICES TO BE ALLOWED IF APPROVED BY THE CITY.
6. GROUND ROD COVER SHALL BE UTILITY VAULT #9VB-924 OR APPROVED EQUIVALENT.

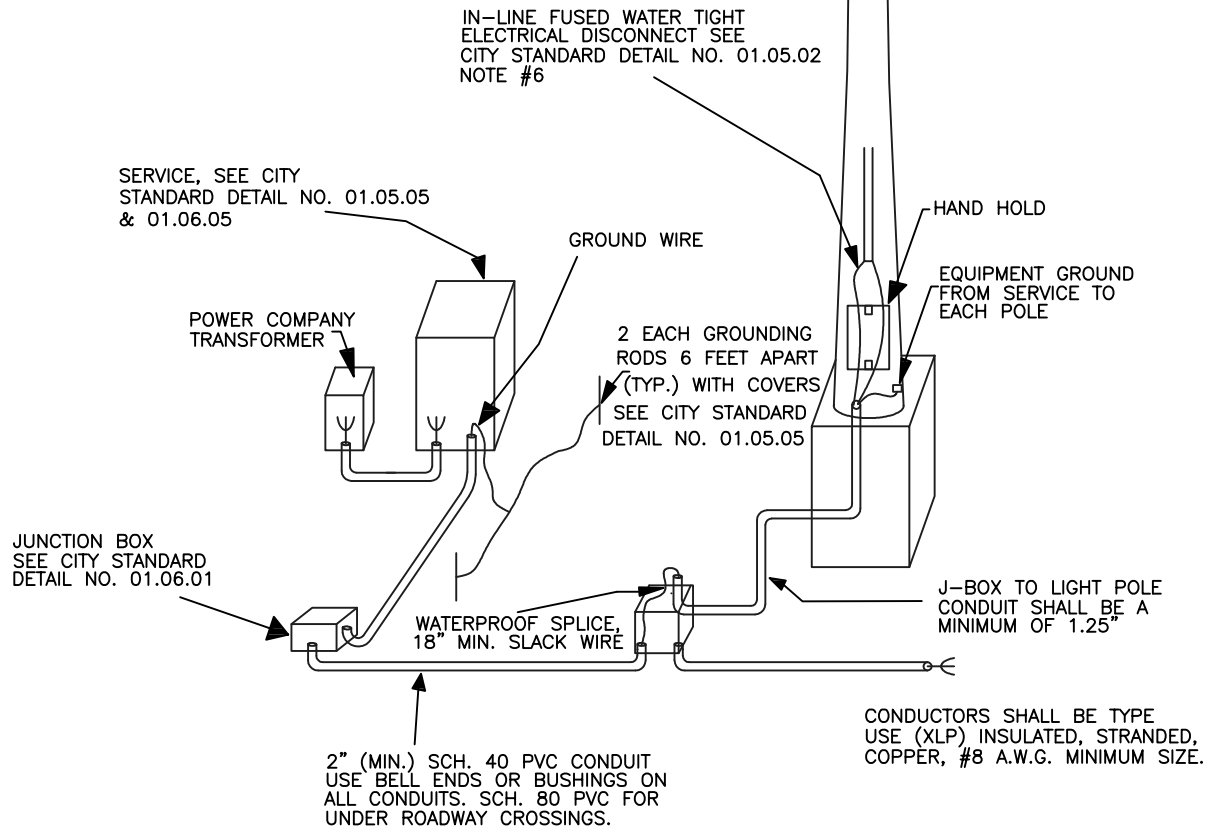

# CITY OF PUYALLUP

DEVELOPMENT ENGINEERING and  
PUBLIC WORKS DEPARTMENTS

## TYPICAL STREET LIGHT INSTALLATION

<b>DRAWN BY</b> JIM ERWIN-SVOBODA	<b>CHECKED BY</b> LINDA LIAN	<b>APPROVED BY</b> COLLEEN HARRIS	<b>REVISED BY</b> LINDA LIAN	<b>CITY STANDARD</b>
<b>FILE NAME</b> F:\DWG\COMMON\STDS\CITY\2009\01_STR\01.05\01.05.03	<b>DATE APPROVED</b> 07/01/2009	<b>DATE REVISED</b> 02/25/2015	<b>SCALE</b> 1:5	<b>01.05.03</b>